


Phalon®

PERTAMA DAN TERBAIK

for cable conduit (SNI 04.1701-1989 & SNI 1702-1989-C)

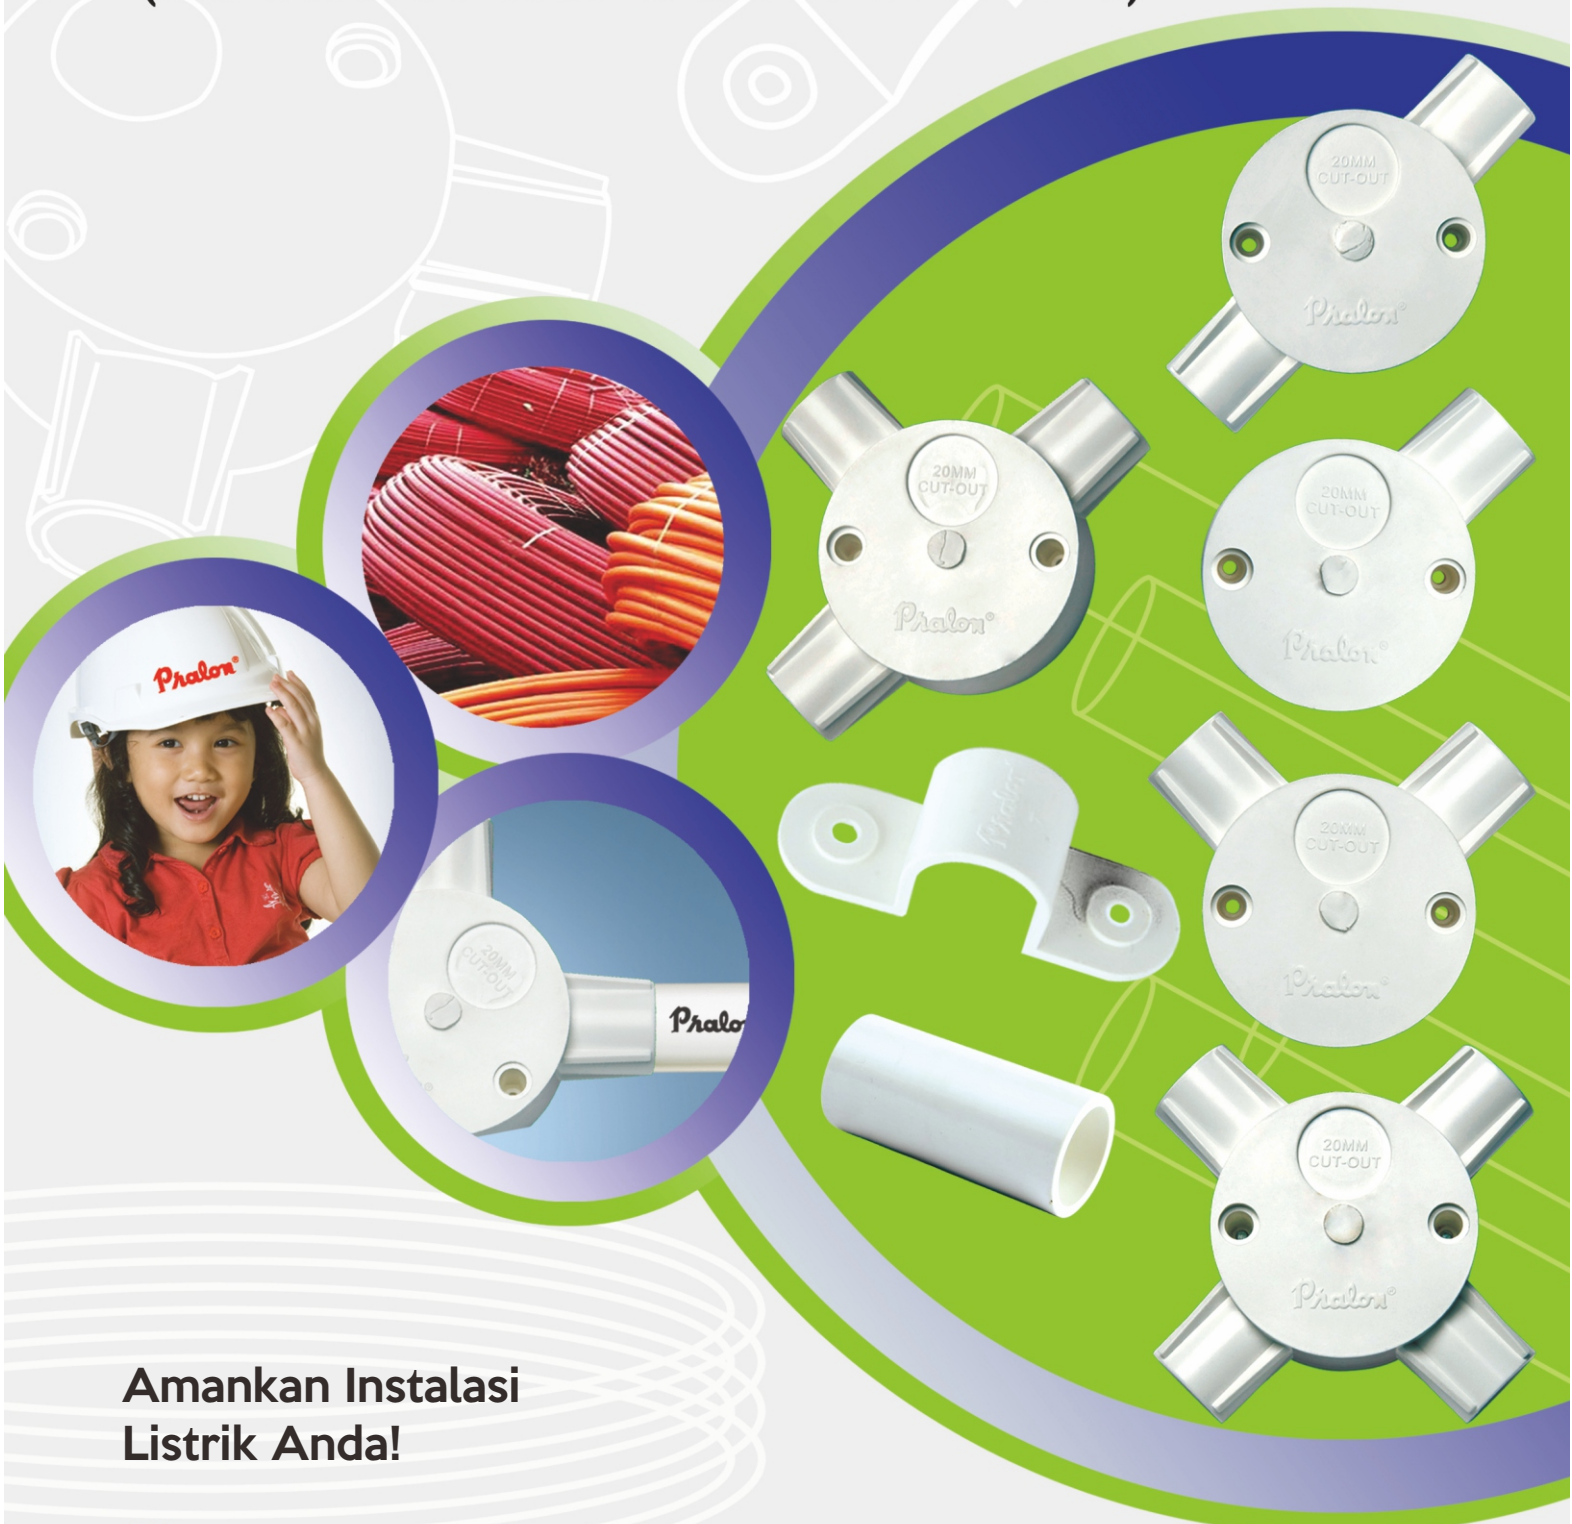

**Amankan Instalasi
Listrik Anda!**




Certificate No : 1109989

Certificate No : 1109990

Certificate No : 1109991

Untuk mengamankan instalasi kabel listrik, gunakan:

1. T Dus 20mm (cab 1, cab 2, cab 3, cab 4)
2. Pipa High Impact Conduit
3. Clamp
4. Socket

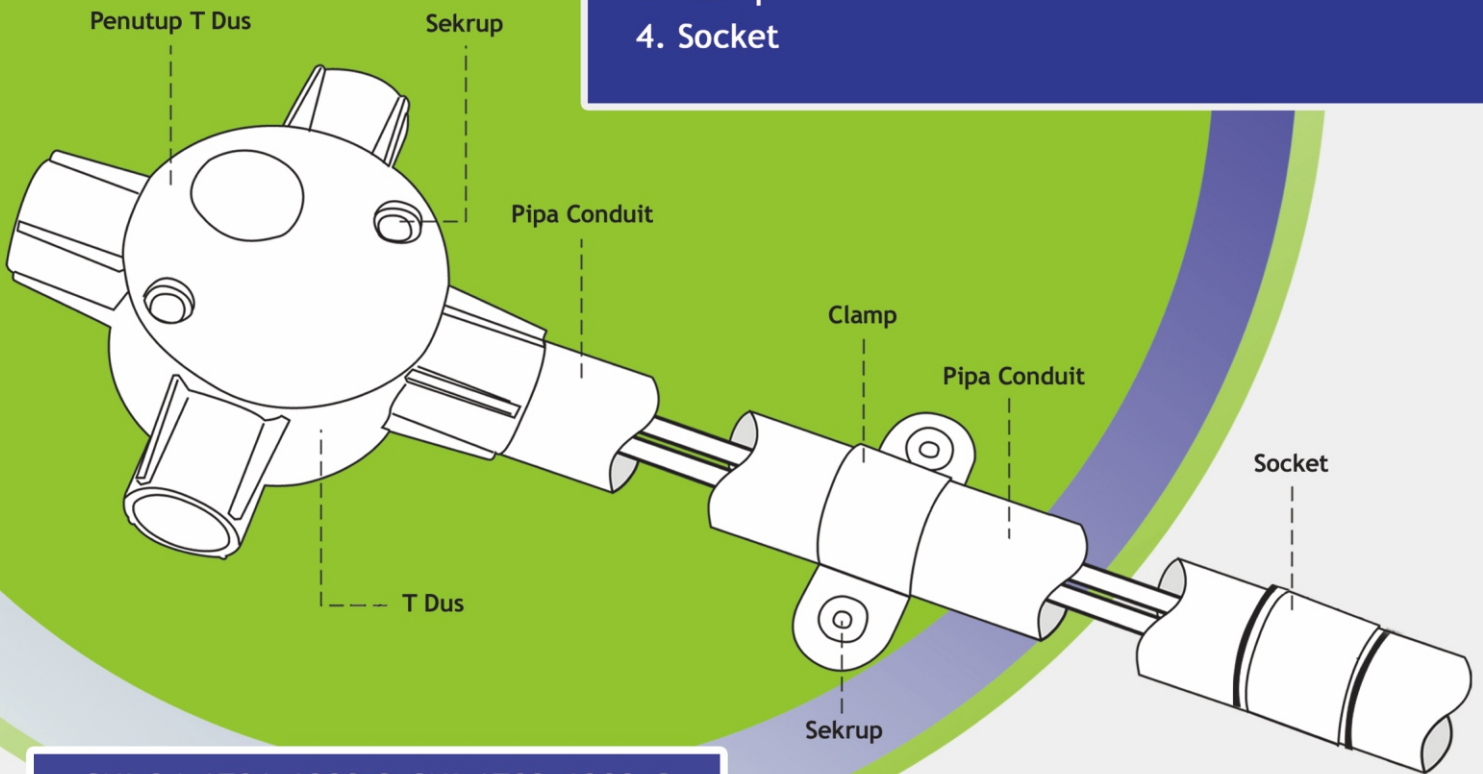

SNI 04.1701-1989 & SNI 1702-1989-C

Outside Diameter (mm)	Wall Thickness (mm)	Length (mm)
20	1.4	2880
25	1.6	2880
32	2.0	2880

Pipa conduit bisa dibengkokkan sesuai dengan arah kabel. Agar sambungan kabel lebih aman dan rapi gunakan T Dus.

Untuk lebih memudahkan penandaan jaringan, tersedia Clamp dan Penutup T Dus yang berwarna

	Listrik
	Telepon
	Fire Alarm
	Elektronik
	Data

Distribusi oleh :



PT. PRALON

www.pralon.com

Email : info@pralon.com

Pusat informasi : (021) 304 38808